

# FLOORCO TRADING LTD.

# TEST REPORT

**SCOPE OF WORK**

FLOORCO Venner SPC flooring

**REPORT NUMBER**

230907003SHF-002

**TEST DATE(S)**

2023-09-07 - 2023-10-08

**ISSUE DATE**

2023-10-17

**PAGES**


14

**DOCUMENT CONTROL NUMBER**

LFT-APAC-SHF-OP-10k(September 1, 2022)

© 2022 INTERTEK

Intertek Testing Services Shenzhen Ltd. Shanghai Fengxian Branch

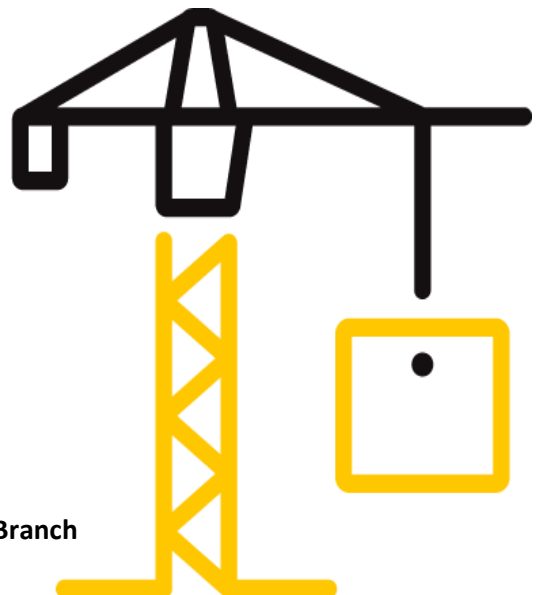

## Test Report

### Statement

- 1.This report is invalid without company's special seal for testing on the assigned page.
- 2.This report is invalid without an authorized person's signature.
- 3.This report is invalid if altered.
- 4.Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Don't copy this report in partial without any official approval in written by our company. This report is invalid without re-stamping the special seal for testing in copying report.
- 5.This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample(s) tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.
- 6.Except for the obligation, responsibility and liability (if any) for the appropriateness and professionalism of afore-mentioned testing itself within the scope and amount of the testing fee received, Intertek does not and will not accept any other obligation or liability.
- 7.If the Client has any questions about the test results, Intertek B&C should be informed within the storage period of the samples. The sample storage period ends 5 working days after the official report issue date. Samples of certification program are retained for the period required by the certification rules. The samples storage period shall be calculated according to the issue date of the original report in the case of quoting results and modifying reports.
- 8.Intertek B&C will service this report for the entire test record retention period. The test record retention period ends 6 years after this report original issue date. The test record retention period for certification program is 10 years. Test records and other pertinent project documentation will be retained for the entire test record retention period.
- 9.The report was digital signed by Shang Hai, Intertek Group plc, please using Adobe Acrobat Reader to verify the authenticity.

## Test Report

Issue Date: 2023-10-17 Intertek Report No. 230907003SHF-002  
Applicant: FLOORCO TRADING LTD.  
Address: 118 CARBINE ROAD, MT WELLINGTON  
Attn: Terry SHI  
Test Type: Performance test, samples provided by the applicant.

### Product Information

<b>Product Name</b>	FLOORCO Venner SPC flooring	<b>Brand</b>	/
<b>Sample Description</b>	Good Condition	<b>Sample Amount</b>	116pcs
		<b>Received Date</b>	2023-08-28
<b>Sample ID</b>	<b>Model</b>	<b>Specification</b>	
S230907003SHF.026~028, 030	WOODFACE	190*6/1*1900+2mm 10X IXPE	

### Test Methods And Standards

<b>Test Standard</b>	With reference to CPSC-CH-C1001-09.4, CPSC-CH-E1002-08.3, With reference to F963-17 section 4.3.5.2(2)(b), CDPH/EHLB/Standard Method V1.2, 2017
<b>Specification Standard</b>	CDPH/EHLB/Standard Method V1.2, 2017
<b>Test Conclusion</b>	The samples were tested according to the above standards, and the results are shown in the following page.

#### Note:

1.This report does not involve sampling. The report only reflects conformity of the tested items of the samples provided by the testing applicant. Representativeness and authenticity of the submitted samples are responsibilities of the testing applicant.

### Report Authorized

  
Flora Fan      Mae Zhang  
Name: Flora Fan      Name: Mae Zhang  
Title: Reviewer      Title: Project Engineer

# Test Report

Issue Date: 2023-10-17

Intertek Report No. 230907003SHF-002

## Test Items, Method and Results:

Test Item: Phthalate content test

Test Method: With reference to CPSC-CH-C1001-09.4, by Gas Chromatographic-Mass Spectrometric (GC-MS) analysis.

Test component list:

1. wear layer
2. base layer
3. under layment

No.	Tested compound	Cas No.	Result (%) (1+2+3)	Limit (%)
1	Dibutyl phthalate (DBP)	84-74-2	ND	0.1
2	Di-(2-ethylhexyl) phthalate (DEHP)	117-81-7	ND	0.1
3	Benzyl butyl phthalate (BBP)	85-68-7	ND	0.1
4	Diisononyl phthalate (DINP)	28553-12-0	ND	0.1
5	Diisobutyl phthalate (DIBP)	84-69-5	ND	0.1
6	Di-n-pentyl phthalate (DPENP)	131-18-0	ND	0.1
7	Di-n-hexyl phthalate (DHEXP)	84-75-3	ND	0.1
8	Dicyclohexyl phthalate (DCHP)	84-61-7	ND	0.1

Note:

1. Detection limit = 0.01%
2. ND = Not detected (less than the detection limit)
3. The above limit was quoted from 16 CFR part 1307 approved by U.S. Consumer Product Safety Commission (CPSC) for prohibition of children's toys and child care articles containing specified phthalates.
4. Test location: Central Chemical Lab of Intertek Testing Services Ltd., Shanghai  
Address: 4-5/F., Block C, No.1218, Wanrong Road, Jing'an District, Shanghai

# Test Report

Issue Date: 2023-10-17

Intertek Report No. 230907003SHF-002

### Test Items, Method and Results:

Test Item: Total Lead (Pb) Content In Non-Surface Coating Materials (Substrate)

Test Method: As per standard operating procedures for determining total Lead (Pb) in children's products, test method(s) CPSC-CH-E1002-08.3 was used and total Lead content was determined by Inductively Coupled Argon Plasma Spectrometry.

Test component list:

1. wear layer
2. base layer
3. under layment

Test Item	Test Result (ppm) (1+2+3)	Limit(ppm)
Total Lead (Pb) Content	ND	100

Note:

1. ppm = Parts per million = mg/kg
2. ND = Not detected (less than the detection limit)
3. Detection limit = 10 ppm
4. The limit was cited from U.S. Consumer Product Safety Improvement Act 2008 title I, section 101 for total Lead content in non-surface coating materials (substrate).
5. Test location: Central Chemical Lab of Intertek Testing Services Ltd., Shanghai  
Address: 4-5/F., Block C, No.1218, Wanrong Road, Jing'an District, Shanghai



# Test Report

Issue Date: 2023-10-17

Intertek Report No. 230907003SHF-002

## Test Items, Method and Results:

Test Item: Soluble elements analysis in non-surface coating materials

Test Method: With reference to section 4.3.5.2(2)(b) of the ASTM standard consumer safety specification on toy safety F963-17, acid extraction method was used and heavy metal elements migration content were determined by Inductively Coupled Argon Plasma Spectrometry.

Test component list:

1. wear layer
2. base layer
3. under layment

Test Item	Test Result (ppm) (1+2+3)	Detection Limit (ppm)	Limit in ASTM F963 (ppm)
Soluble Barium (Ba)	ND	5	1000
Soluble Lead (Pb)	ND	5	90
Soluble Cadmium (Cd)	ND	5	75
Soluble Antimony (Sb)	ND	5	60
Soluble Selenium (Se)	ND	5	500
Soluble Chromium (Cr)	ND	5	60
Soluble Mercury (Hg)	ND	5	60
Soluble Arsenic (As)	ND	2.5	25

Note:

1. ppm = parts per million = mg/kg
2. ND = Not detected (less than the detection limit)
3. Test location: Central Chemical Lab of Intertek Testing Services Ltd., Shanghai  
Address: 4-5/F., Block C, No.1218, Wanrong Road, Jing'an District, Shanghai

# Test Report

Issue Date: 2023-10-17

Intertek Report No. 230907003SHF-002

**Test Items, Method and Results:****1. Test Standard:**

CDPH/EHLB/Standard Method V1.2, 2017

Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources using Environmental Chambers Version 1.2 - Emission testing method for California Specification 01350

**2. Test Method: With reference to**

ASTM D5197-16 Standard Test Method for Determination of Formaldehyde and Other Carbonyl Compounds in Air (Active Sampler Methodology);

ASTM D6196-15<sup>e1</sup> Standard Practice for Choosing Sorbents, Sampling Parameters and Thermal Desorption Analytical Conditions for Monitoring Volatile Organic Chemicals in Air;

U.S. EPA Methods TO-17 Determination of Volatile Organic Compounds in Ambient Air Using Active Sampling Onto Sorbent Tubes;

ISO 16000-9:2006 Indoor air - Part 9: Determination of the emission of volatile organic compounds from building products and furnishing - Emission test chamber method;

ISO 16000-11:2006 Indoor air - Part 11: Determination of the emission of volatile organic compounds from building products and furnishing - Sampling, storage of samples and preparation of test specimens.

**3. Test Procedure:**

The sample was tested in the emission test chamber. After defined times, chamber air samples were collected. Samples analyzed for individual VOCs and TVOC were collected on sorbent tubes Tenax TA, and were detected by Automatic Thermal Desorption-Gas Chromatography/Mass Spectrometric (ATD-GC/MS). Samples analyzed for aldehydes were collected on DNPH cartridge, and were detected by High Performance Liquid Chromatography (HPLC).

**4. Conditioning of the sample until testing date: 23°C±2°C, 50%±5%, 10days****5. Test condition:**Test chamber: 0.06 m<sup>3</sup>Exposed sample surface area: 0.06 m<sup>2</sup>Loading factor: 1.0 m<sup>2</sup>/m<sup>3</sup>

Supply air temper: 23°C±1°C

Supply air humidity: 50%±5% R.H.

Air exchange rate: 1.0 h<sup>-1</sup>

Area specific flow rate: 1.0 m/h

Sampling: Tenax TA &amp; DNPH cartridge

# Test Report

Issue Date: 2023-10-17

Intertek Report No. 230907003SHF-002

6. Test result:

Table 1 Evaluation for different scenarios

Modeling scenario	Verdict(Pass/Fail)
Standard school classroom (SC)	Pass
Private office (PO)	Pass
Single family residence (R)*	Pass

Remark: \*The single family residence modeling scenario is not yet a requirement and is for informational purposes only.

Table 2 24h, 48h and 96h Chamber Concentration and Emission Factor of Formaldehyde and TVOC

Parameter	CAS number	Chamber Concentration (µg/m <sup>3</sup> )			Emission Factor (µg/m <sup>2</sup> ·h)		
		24h	48h	96h	24h	48h	96h
Formaldehyde <sup>#</sup>	50-00-0	5.2	5.2	3.5	5.2	5.2	3.5
TVOC	/	<10	<10	<10	<10	<10	<10

Table 3 96h Chamber concentration and Emission Factor of all Target VOCs

No.	Compound Name	CAS Number	Chamber Concentration (µg/m <sup>3</sup> )	Emission Factor (µg/m <sup>2</sup> ·h)
1	Acetaldehyde <sup>#</sup>	75-07-0	<2	<2
2	Benzene	71-43-2	<2	<2
3	Carbon disulfide	75-15-0	<2	<2
4	Carbon tetrachloride	56-23-5	<2	<2
5	Chlorobenzene	108-90-7	<2	<2
6	Chloroform	67-66-3	<2	<2
7	Dichlorobenzene (1,4-)	106-46-7	<2	<2
8	Dichloroethylene (1,1)	75-35-4	<2	<2
9	Dimethylformamide (N,N-)	68-12-2	<2	<2
10	Dioxane (1,4-)	123-91-1	<2	<2
11	Epichlorohydrin	106-89-8	<2	<2
12	Ethylbenzene	100-41-4	<2	<2
13	Ethylene glycol	107-21-1	<2	<2
14	Ethylene glycol monoethyl ether	110-80-5	<2	<2
15	Ethylene glycol monoethyl ether acetate	111-15-9	<2	<2
16	Ethylene glycol monomethyl ether	109-86-4	<2	<2



# Test Report

Issue Date: 2023-10-17

Intertek Report No. 230907003SHF-002

17	Ethylene glycol monomethyl ether acetate	110-49-6	<2	<2
18	Formaldehyde <sup>#</sup>	50-00-0	3.5	3.5
19	Hexane (n-)	110-54-3	<2	<2
20	Isophorone	78-59-1	<2	<2
21	Isopropanol	67-63-0	<2	<2
22	Methyl chloroform	71-55-6	<2	<2
23	Methylene chloride	75-09-2	<2	<2
24	Methyl t-butyl ether	1634-04-4	<2	<2
25	Naphthalene	91-20-3	<2	<2
26	Phenol	108-95-2	<2	<2
27	Propylene glycol monomethyl ether	107-98-2	<2	<2
28	Styrene	100-42-5	<2	<2
29	Tetrachloroethylene	127-18-4	<2	<2
30	Toluene	108-88-3	<2	<2
31	Trichloroethylene	79-01-6	<2	<2
32	Vinyl acetate	108-05-4	<2	<2
33~35	Xylenes, technical mixture (m-, o-, p-xylene combined)	108-38-3 95-47-6 106-42-3	<2	<2

Table 4 VOCs detected above lower limits of quantitation in air samples at 96h

Compound Name	CAS No.	SURROGATE <sup>1</sup>	CREL (µg/m <sup>3</sup> ) <sup>2</sup>	CARB TAC <sup>3</sup>	PROP 65 LIST <sup>4</sup>	Chamber Concentration (µg/m <sup>3</sup> )	Emission Factor (µg/m <sup>2</sup> ·h)
Formaldehyde <sup>#</sup>	50-00-0	/	9	YES	YES	3.5	3.5

# Test Report

Issue Date: 2023-10-17

Intertek Report No. 230907003SHF-002

Table 5 Top ten VOCs having the highest emission factors in 96h

Compound Name	CAS No.	SURROGATE <sup>1</sup>	CREL ( $\mu\text{g}/\text{m}^3$ ) <sup>2</sup>	CARB TAC <sup>3</sup>	PROP 65 LIST <sup>4</sup>	Chamber Concentration ( $\mu\text{g}/\text{m}^3$ )	Emission Factor ( $\mu\text{g}/\text{m}^2\cdot\text{h}$ )
Formaldehyde#	50-00-0	/	9	YES	YES	3.5	3.5

Note:

1. Indicates which non-listed VOCs were quantified using surrogate compounds, all other compounds were quantified using pure compounds.
2. Chronic Reference Exposure Level (CREL) as defined by California Office of Environmental Health Hazard Assessment.
3. Substance is listed on California Air Resource Board's (CARB) Toxic Air Contaminate (TAC) identification list.
4. Substance known to the state of California to cause cancer or reproductive toxicity according to California's Safe Drinking Water and Toxic Enforcement Act of 1986 (Proposition 65)
5. # = indicates aldehydes identified and quantified by DNPH derivatization and HPLC/DAD analysis.
6. TVOC means sum of the concentrations of all identified and unidentified VOCs between and including n-pentane through n-heptadecane (i.e., C<sub>5</sub>-C<sub>17</sub>) as measured by the GC/MS TIC method and expressed as a toluene equivalent value.
7. Detection limit of individual compound = 2  $\mu\text{g}/\text{m}^3$   
Detection limit of TVOC = 10  $\mu\text{g}/\text{m}^3$
8. Test location: Central Chemical Lab of Intertek Testing Services Ltd., Wuxi  
Address: No. 8, Fubei Road, Xishan Economic Development Zone, Wuxi, China

# Test Report

Issue Date: 2023-10-17

Intertek Report No. 230907003SHF-002

7. Estimated Concentration for different scenarios and evaluation of the requirement.

Table 6 Parameters to be used for estimation of VOC concentrations

Scenario	Room Size(m <sup>3</sup> )	Floor coverings Area (m <sup>2</sup> )	Effective outdoor air change rate (h <sup>-1</sup> )	Air Flow Rate (m <sup>3</sup> /h)
Standard school classroom	231	89.2	0.82	191
Private office	30.6	11.1	0.68	20.7
Single family residence	547	211	0.23	127

Remark:

The above parameters are cited from section 01350 table 4-2, 4-3, for Standard school classroom, and table 4-4, 4-5 for Private office, and table B-1, B-2 for single family residence.

Table 7 Estimated Concentration of all Target VOCs for different scenarios and evaluation of the requirement

No.	Compound Name	CAS Number	Estimated concentration (µg/m <sup>3</sup> )			Allowable Concentration (µg/m <sup>3</sup> )	Verdict (Pass/Fail)		
			SC	PO	R		SC	PO	R
1	Acetaldehyde <sup>#</sup>	75-07-0	<0.9	<1.1	<3.3	70	Pass	Pass	Pass
2	Benzene	71-43-2	<0.9	<1.1	<3.3*	1.5	Pass	Pass	Pass
3	Carbon disulfide	75-15-0	<0.9	<1.1	<3.3	400	Pass	Pass	Pass
4	Carbon tetrachloride	56-23-5	<0.9	<1.1	<3.3	20	Pass	Pass	Pass
5	Chlorobenzene	108-90-7	<0.9	<1.1	<3.3	500	Pass	Pass	Pass
6	Chloroform	67-66-3	<0.9	<1.1	<3.3	150	Pass	Pass	Pass
7	Dichlorobenzene (1,4-)	106-46-7	<0.9	<1.1	<3.3	400	Pass	Pass	Pass
8	Dichloroethylene (1,1)	75-35-4	<0.9	<1.1	<3.3	35	Pass	Pass	Pass
9	Dimethylformamide (N,N-)	68-12-2	<0.9	<1.1	<3.3	40	Pass	Pass	Pass
10	Dioxane (1,4-)	123-91-1	<0.9	<1.1	<3.3	1500	Pass	Pass	Pass
11	Epichlorohydrin	106-89-8	<0.9	<1.1	<3.3*	1.5	Pass	Pass	Pass
12	Ethylbenzene	100-41-4	<0.9	<1.1	<3.3	1000	Pass	Pass	Pass
13	Ethylene glycol	107-21-1	<0.9	<1.1	<3.3	200	Pass	Pass	Pass
14	Ethylene glycol monoethyl ether	110-80-5	<0.9	<1.1	<3.3	35	Pass	Pass	Pass
15	Ethylene glycol monoethyl ether acetate	111-15-9	<0.9	<1.1	<3.3	150	Pass	Pass	Pass

# Test Report

Issue Date: 2023-10-17

Intertek Report No. 230907003SHF-002

16	Ethylene glycol monomethyl ether	109-86-4	<0.9	<1.1	<3.3	30	Pass	Pass	Pass
17	Ethylene glycol monomethyl ether acetate	110-49-6	<0.9	<1.1	<3.3	45	Pass	Pass	Pass
18	Formaldehyde <sup>#</sup>	50-00-0	1.6	1.9	5.8	9	Pass	Pass	Pass
19	Hexane (n-)	110-54-3	<0.9	<1.1	<3.3	3500	Pass	Pass	Pass
20	Isophorone	78-59-1	<0.9	<1.1	<3.3	1000	Pass	Pass	Pass
21	Isopropanol	67-63-0	<0.9	<1.1	<3.3	3500	Pass	Pass	Pass
22	Methyl chloroform	71-55-6	<0.9	<1.1	<3.3	500	Pass	Pass	Pass
23	Methylene chloride	75-09-2	<0.9	<1.1	<3.3	200	Pass	Pass	Pass
24	Methyl t-butyl ether	1634-04-4	<0.9	<1.1	<3.3	4000	Pass	Pass	Pass
25	Naphthalene	91-20-3	<0.9	<1.1	<3.3	4.5	Pass	Pass	Pass
26	Phenol	108-95-2	<0.9	<1.1	<3.3	100	Pass	Pass	Pass
27	Propylene glycol monomethyl ether	107-98-2	<0.9	<1.1	<3.3	3500	Pass	Pass	Pass
28	Styrene	100-42-5	<0.9	<1.1	<3.3	450	Pass	Pass	Pass
29	Tetrachloroethylene	127-18-4	<0.9	<1.1	<3.3	17.5	Pass	Pass	Pass
30	Toluene	108-88-3	<0.9	<1.1	<3.3	150	Pass	Pass	Pass
31	Trichloroethylene	79-01-6	<0.9	<1.1	<3.3	300	Pass	Pass	Pass
32	Vinyl acetate	108-05-4	<0.9	<1.1	<3.3	100	Pass	Pass	Pass
33~35	Xylenes, technical mixture (m-, o-, p-xylene combined)	108-38-3 95-47-6 106-42-3	<0.9	<1.1	<3.3	350	Pass	Pass	Pass
36	TVOC	—	<4.7	<5.4	<16.6	—	—	—	—

Remark:

1. The Allowable Concentration is cited from Section 01350 table 4-1, no requirement for TVOC.
2. \*Individual VOC of concern is below lower limits of quantitation for modeled scenario.

Table 8 Estimated Concentration of non-listed VOCs for different scenarios


No.	Compound Name	CAS Number	Estimated concentration (µg/m <sup>3</sup> )		
			SC	PO	R
1	Not Detected	/	/	/	/

# Test Report

Issue Date: 2023-10-17

Intertek Report No. 230907003SHF-002

**Test Photo:**

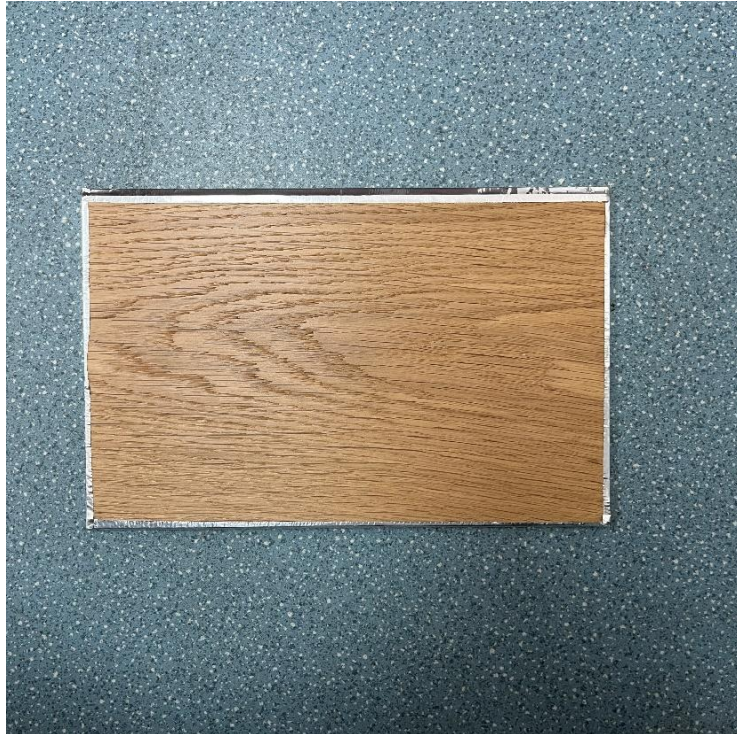

## Test Report

Issue Date: 2023-10-17

Intertek Report No. 230907003SHF-002

### Appendix A: Sample Received Photo



### Revision:

NO.	Date	Changes
230907003SHF-002	2023-10-17	First issue

